



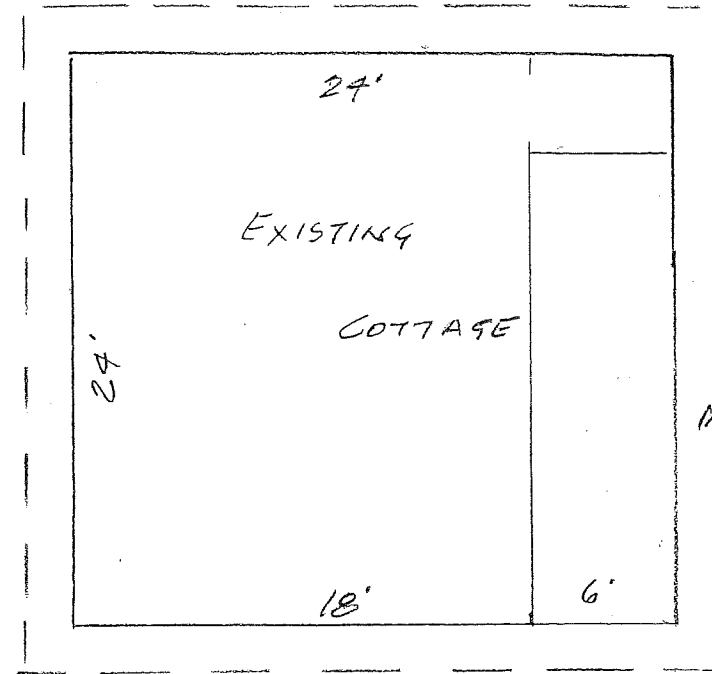

FLOOR PLAN

SCALE 1/8" = 1'-0"

ADD FOUNDATION INSULATION
SEE SECTION

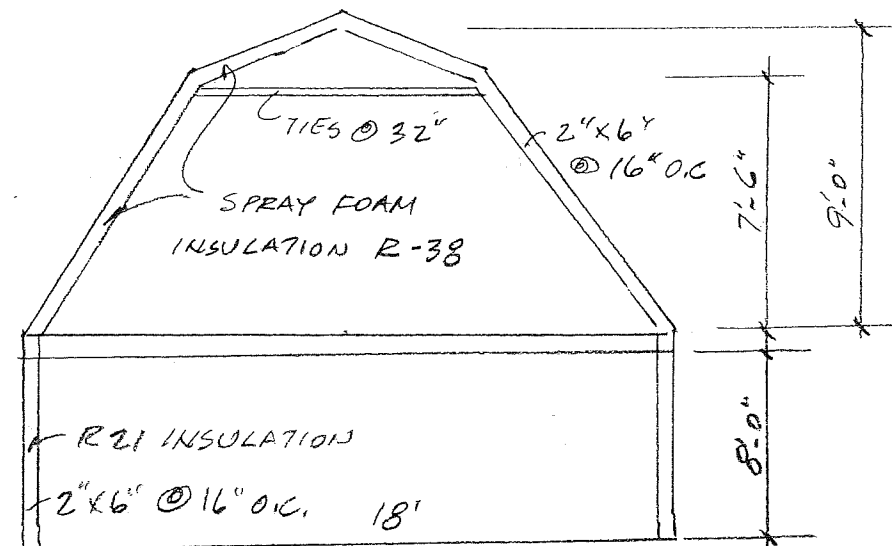


INSULATION DETAIL

3/16" = 1'-0"

ITEMS TO BE CORRECTED

1. FOUNDATION INSULATION
2. ENERGY COMPLIANCE REPORT
3. EGRESS WINDOW SECOND FLOOR (ONE ROOM)
4. ROOF TRUSS CERTIFICATION

CHANGE ONE WINDOW ON SECOND FLOOR
TO EGRESS WINDOW ANDERSON NO 3046 3'-2 1/8" X 4'-9 1/4" R.O
CLEAR OPENING 5.7 SF

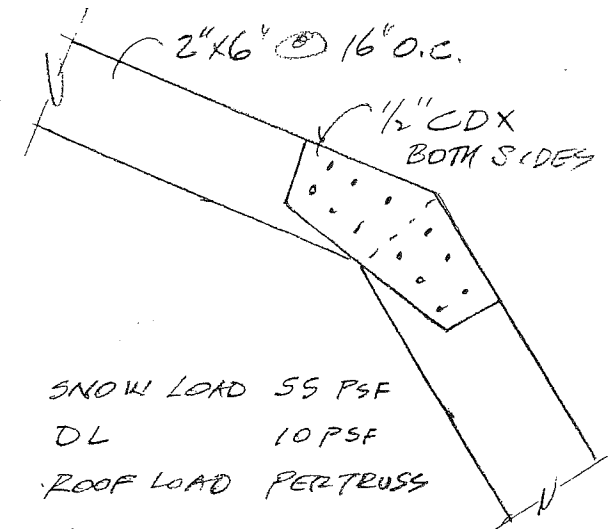


SNOW LOAD 55 PSF
DL 10 PSF
ROOF LOAD PER TRUSS
9'X 65 PSF X 1.33 = 778#

FASTENERS $\frac{778}{74} = 11.6d$

USE 6-6d NAILS WITH
1/2" CD X GUSSET BOTH SIDES

TRUSS DETAIL

SCALE 1/2" = 1'-0"

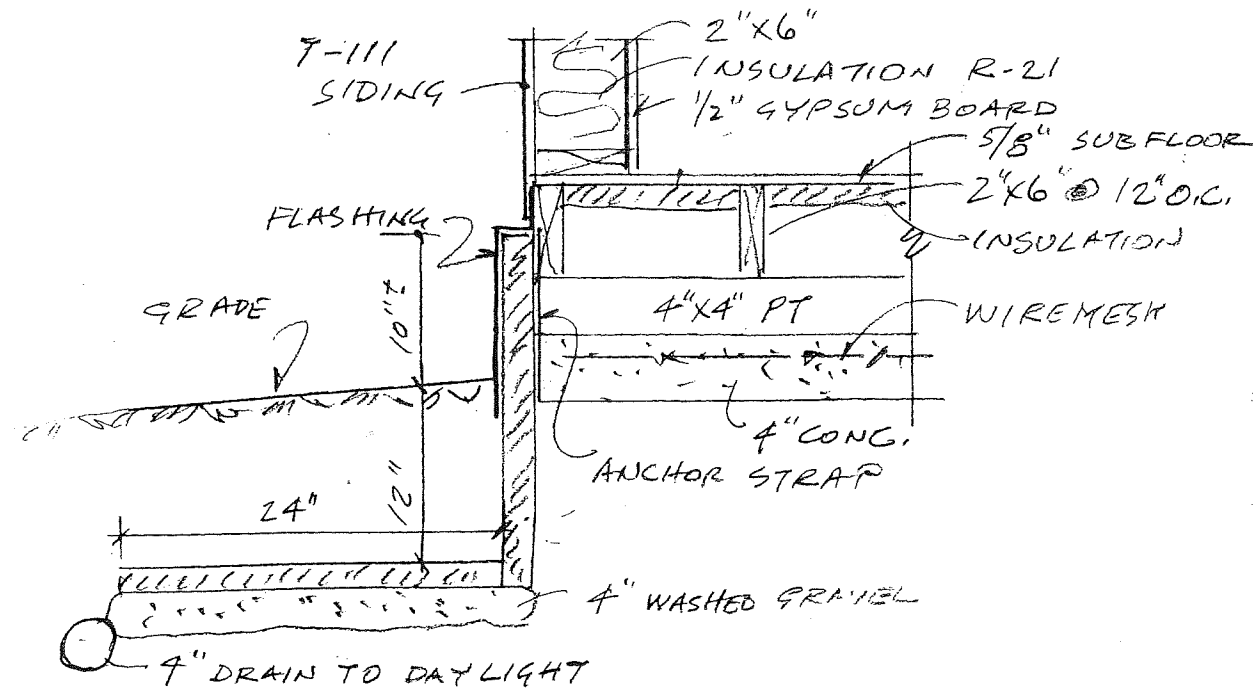

SECTION

SCALE 1/2" = 1'-0"

Date	Revision
Jonathon Appavoo 698 County Highway 166 - Middlefield COTTAGE CODE CORRECTIONS	
Johannes de Waal, P.E. Architectural - Civil - Sanitary Systems PO Box - 1341 Richfield Springs - NY 13439	
Johannes de Waal 8/17/13 Johannes de Waal - Professional Engineer - N.Y. license No. 52227	
Date AUG 13	Scale AS NOTED
Drawing No. 1	Sheet No. 1 OF 1